APOLLO AE-SERIES ELECTRIC ACTUATORS

General Installation, Operation, Specifications, Maintenance and Trouble Shooting Instructions

The following is intended as a guide only in installing and operating the electric actuator. The manufacturer assumes no liability whatsoever for any personal injury or other special or consequential damages that may occur. There are no warranties as to suitability for a specific application or purpose.

Installation / Mechanical Operation

- Verify that the valve breakaway torque is less than the rated output torque of the actuator.
- Any mechanical stops that would interfere with the operation of the actuator must be removed before installation of the actuator, i.e. lever, travel stops, etc.
- The actuator output coupling must be centered with the valve stem to prevent side loading, which causes premature stem packing wear.
- The AE-Series actuator is not recommended for actuation of butterfly valves or other similar resilient seated valves, unless installed with Motor Break option.
- To use the manual override feature (identified on cover label), the override shaft must be pressed down firmly at least 1/4" in order to disengage the motor from the gears. The manual override is not designed to overcome torque in excess of the rated torque of the actuator. Serious damage to the gear system may result from excessive turning force on the manual override.
- The AE-Series actuator may be mounted in any position, i.e. horizontal, upside down. If the
 conduit entrance points upward, conduit piping must be oriented as to prevent condensation from
 entering the actuator from the conduit pipe.

Electrical Operation

- Always verify that the supply voltage and required voltage are the same.
- AE-series 24VAC, 115VAC and 230VAC actuators use capacitor run-reverse induction motors, which create higher feedback voltages that the supply voltage. Control devices connected to terminals 3 and 4 must be rated for 250VAC minimum for 15VAC actuators, (440VAC min. for 230VAC actuators: 125VAC min. for 24VAC).
- Do not wire actuators in series or parallel with another actuator or other electrical equipment due to the induction feedback voltage created by the motor.
- Separate (isolated contacts) are required for each actuator.
- When wiring DC voltage actuators, verify that terminal polarity is correct (pos.+ & Neg.-). Failure to do so will cause the actuator to operate out of its normal 90 degree rotation.
- The AE-Series actuators are designed to operate at 25% duty cycle at temperatures below 100°F. This means that for a cycle time of 25 seconds the actuator must rest for 75 seconds. This is an average. For example: The actuator may cycle several times in a row, but must rest for a period 75% longer that the time it operated.
- All models require electrical power to both OPEN and to CLOSE the actuator and valve.

Maintenance

Under normal circumstances the actuator will not require additional lubrication. All of the actuator's essential components are permanently lubricated at the factory.

- Seal conduit entrances to prevent water or dirt from entering the housing. Excessive moisture can cause premature wear or corrosion within the housing.
- Periodically inspect actuator and valve assembly for worn parts, loose fasteners, or damage to the outside of the unit.

General Specifications

| Actuator Model | Breakaway Torque Output (inlbs.) | Cycle Time 90° Travel | me Cycle* Amperage Draw (max.) Starting or locked rotor current vo | | | , | tage | |
|-------------------|---|--------------------------------|--|--------|---------|---------|-------|-------|
| | (| (50% Load) | | 24 VAC | 115VAC | 230VAC | 12VDC | 24VDC |
| AE200 | 200 in-lbs. | 5.0 sec. | 25% | 4.56 | .74 amp | .44 amp | 2.00 | 1.38 |
| | | | | amp | | | amp | amp |
| AE400 | 400 in-lbs. | 10.0 sec. | 25% | 4.56 | .74 amp | .44 amp | 2.00 | 1.38 |
| | | | | amp | | | amp | amp |
| AE600 | 600 in-lbs. | 15.0 sec. | 25% | 4.56 | .74 amp | .44 amp | 2.00 | 1.38 |
| | | | | amp | | | amp | amp |
| AE800 | 800 in-lbs. | 20.0 sec. | 25% | 4.56 | .74 amp | .44 amp | 2.00 | 1.38 |
| | | | | amp | | | amp | amp |
| AE1000 | 1000 in-lbs. | 25.0 sec. | 25% | 4.56 | .74 amp | .44 amp | 2.00 | 1.38 |
| | | | | amp | | | amp | amp |

Note: 90° Travel = Travel From Closed position to Open position or vice versa.

* Duty Cycle for 24VAC will be approximately 20%.


| Motor | AC models: 24 VAC, 120 VAC or 230 VAC, Reversible. 3 wire, capacitor run. Self-resetting thermal overload protection, Class B insulation, sub-fractional horsepower. DC models: 12 VDC or 24 VDC, Reversible. 2 wire, POS. & NEG. No thermal overload (external circuit breaker or fuse suggested for protection). |
|-----------------------------|---|
| Lubrication | Permanently lubricated gear train and bearings. |
| Duty Cycle | The AE-Series actuators are designed to operate at 25% duty cycle at temperatures below 100°F. See Electrical Operation. |
| Temperature Operating Range | 32°F to 150°F standard |
| | -40°F to 150°F with optional heater & thermostat |
| Thermal Protection | Self-resetting (AC Motors Only) |
| Conduit Connections | (2) 1/2"-NPT female |
| Direction Of Travel | Clockwise to Close, Counterclockwise to Open (Position |
| | indicator shaft only, manual override shaft rotates opposite) |

AE-SERIES NUMBERING SYSTEM

| Constant | Torque | Voltage | Options |
|----------|---------------------|-------------|---------------------------------|
| | 200 | 1 = 115 vac | 0 = Standard |
| | 400 | 2 = 24 vac | A = One extra switch & cams |
| | 600 | 3 = 220 vac | B = Two extra switches & cams |
| | 800 | 4 = 12 vac | C = Three extra switches & cams |
| | 1000 | 5 = 24 vac | D = Heater & Thermostat |
| | | | E = Single Potentiometer |
| | Enter all digits of | | F = Motor Break |
| | Torque value | | |

Note: AE will always be the first two characters of the part number, all digits from torque value must be entered into part number (i.e. 400, 1000 etc.). Only use one digit for voltage depiction (i.e. 1-5). For the options listing you may use more than one character, up to three (i.e. 0, AD or BD etc.).

24/115/230 VAC Wiring Diagram

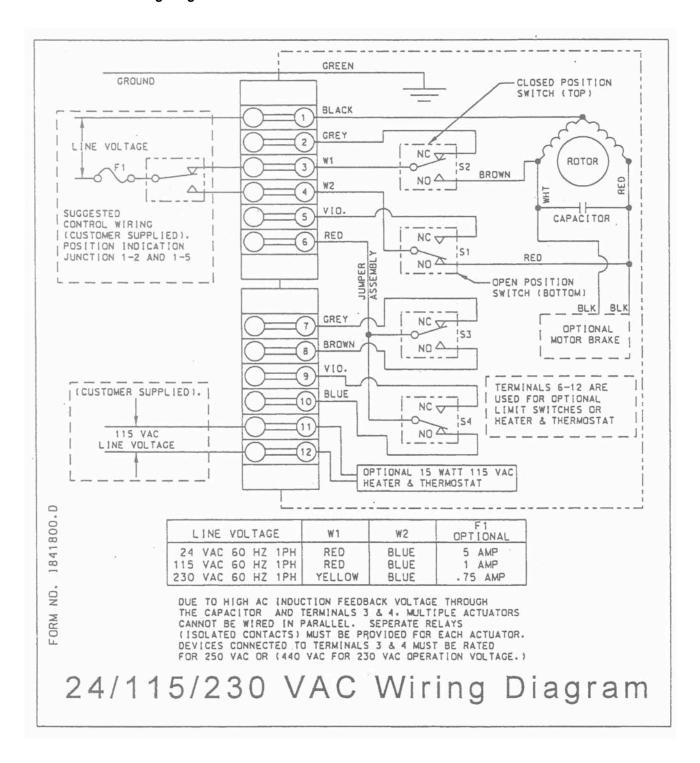

SUGGESTED CONTROL WIRING (CUSTOMER SUPPLIED). POSITIION INDICATOR JUNCTION 1-2 AND 1-5.

(CUSTOMER SUPPLIED). 115 VAC LINE VOLTAGE

CLOSED POSITION SWITCH (TOP)

OPEN POSITION SWITCH (BOTTOM)

OPTIONAL MOTOR RREAK


TERMINALS 6-12 ARE USED FOR OPTIONAL LIMIT SWITCHES OR HEATER & THERMOSTAT

OPTIONAL 15 WATT 115 VAC HEATER & THERMOSTAT

| LINE VOLTAGE | W1 | W2 | F1 OPTIONAL |
|--------------------|--------|------|-------------|
| 24 VAC 60 HZ 1 PH | RED | BLUE | 5 AMP |
| 115 VAC 60 HZ 1 PH | RED | BLUE | 1 AMP |
| 230 VAC 60 HZ 1 PH | YELLOW | BLUE | .75 AMP |

DUE TO HIGH AC INDUCTION FEEDBACK VOLTAGE THROUGH THE CAPACITOR AND TERMINALS 3 & 4, MULTIPLE ACTUATORS CANNOT BE WIRED IN PARALLEL. SEPARATE RELAYS (ISOLATED CONTACTS) MUST BE PROVIDED FOR EACH ACTUATOR. DEVICES CONNECTED TO TERMINALS 3 & 4 MUST BE RATED FOR 250 VAC OR (440 VAC FOR 230 VAC OPERATION VOLTAGE).

12/24 VDC WIRING DIAGRAM

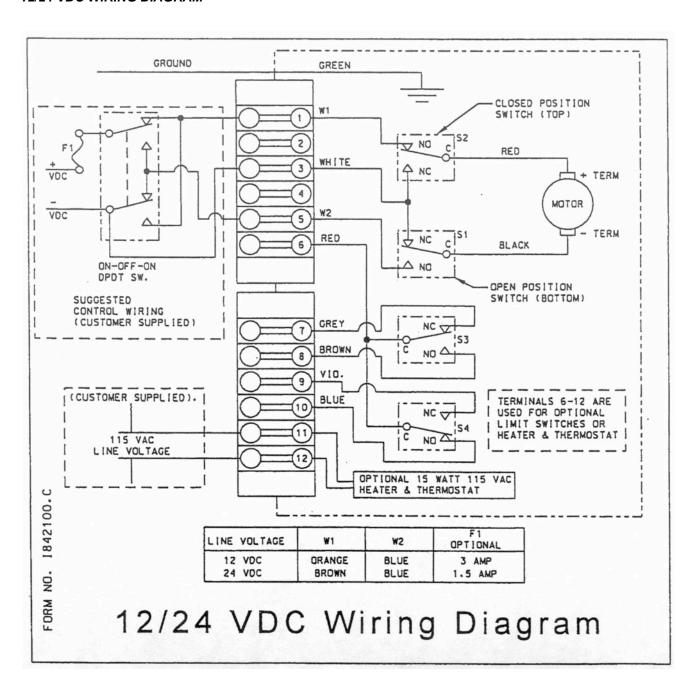

ON-OF-ON DPDT SW.

SUGGESTED CONTROL WIRING (CUSTOMER SUPPLIED)

(CUSTOMER SUPPLIED). 115 VAC LINE VOLTAGE

CLOSED POSITION SWITCH (TOP)

RED +TERM MOTOR – TERM BLACK

OPEN POSITION SWITCH (BOTTOM)

TERMINALS 6-12 ARE USED FOR OPTIONAL LIMIT SWITCHES OR HEATER & THERMOSTAT

OPTIONAL 15 WATT 115 VAC HEATER & THERMOSTAT

| LINE VOLTAGE | W1 | W2 | F1 OPTIONAL |
|--------------|--------|------|-------------|
| 12 VDC | ORANGE | BLUE | 3 AMP |
| 24 VDC | BROWN | BLUE | 1.5 AMP |

MANUAL OVERRIDE SHAFT .312 SQUARE

CPTIVE SCREWS ARE 1/4" - 20 UNC SOCKET HEAD CAP SCREWS, 6 PLACES

INDICATOR - SHOWN IN CLOSED POSITION

1/2" NPT, TYPICAL BOTH SIDES

3.5" CLEARANCE (FROM TOP OF OVERRIDE SHAFT) REQUIRED FOR COVER REMOVAL

5/16-18 UNC X .62 DEEP 4 PLACES TYPICAL

02.756 B.C.


.748 SQUARE .747 X .87 DEEP


.975


1.949 SQUARE


MOUNTING PATTERN ISO 5211 - F07

AE-SERIES DIMENSIONS

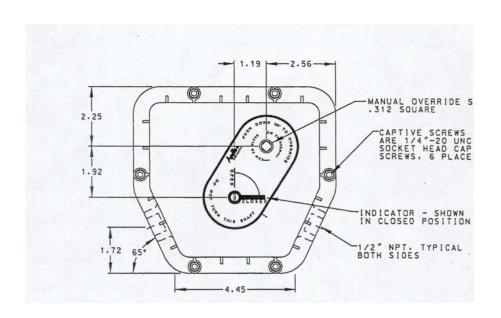

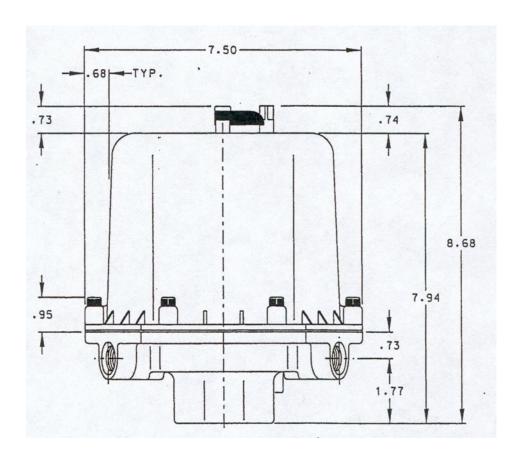

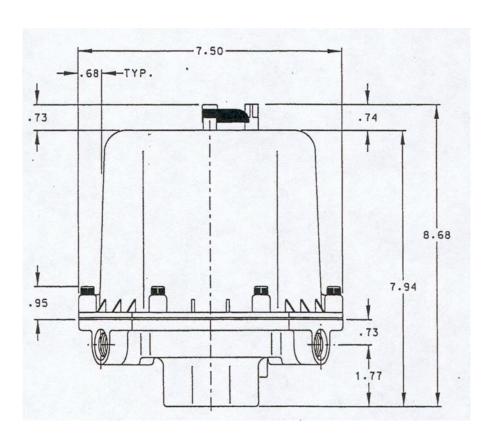

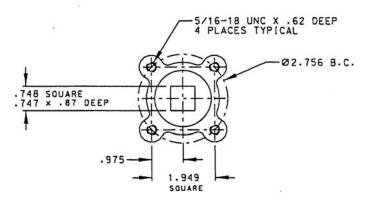

MOUNTING PATTERN ISO 5211 - F07